


NOTES:

- ① Minimum vertical separation at all utility crossings shall be 6".
- ② All objects placed behind the curb face shall maintain a minimum horizontal clearance of 18" or as required by the applicable Engineering Standard.
- ③ Maintain 5' minimum horizontal separation between utilities.
- ④ Communication utilities shall be placed 3' minimum below crossing utilities or 7' below top of curb, whichever is deeper.

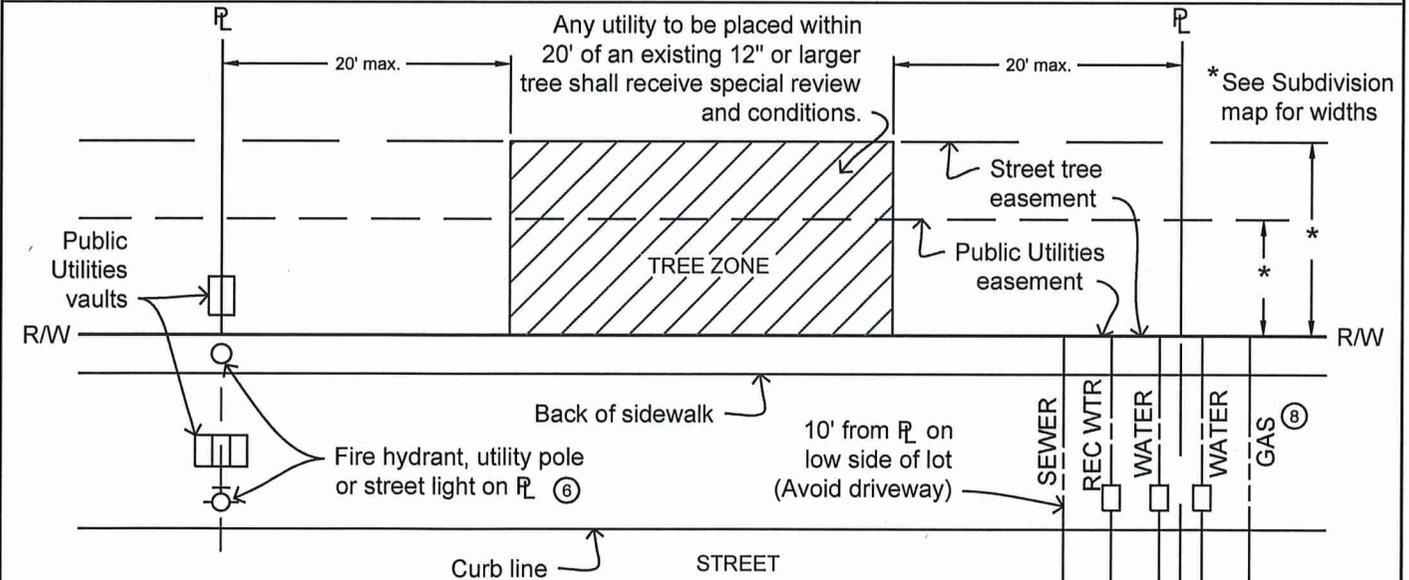

NOTES (cont'd):

- ⑥ Hydrants shall be installed per Engineering Standard Detail W-1.
- ⑦ 3' minimum horizontal clearance between unlike utility services.
- ⑧ Gas lines shall share trench with wire utilities per plans or standards approved by all Utilities occupying trench, unless specifically allowed by the City.

REVISIONS	BY	APP	DATE

STANDARD CURRENT AS OF: JANUARY 2022



UTILITIES LOCATION